

# TEST REPORT

No. : XMIN190100111CCM

Date : Jan.22, 2019

Page: 1 of 2

CUSTOMER NAME: ENDUTEX REVESTIMENTOS TEXTEIS, S. A  
ADDRESS: RUA DA BAIONA 22, 4795-784 VILARINHO S-TIRSO

Sample Name : PRINT FLOOR  
Material : PVC COATED POLYESTER WOVEN FABRIC  
Spec : 85% PVC AND 15 POLYESTER  
Manufacturer : ENDUTEX REVESTIMENTOS TEXTEIS, S. A

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

\*\*\*\*\*

Test Required : Selected test(s) as requested by applicant  
Date of Receipt : Jan.16, 2019  
Testing Start Date : Jan.16, 2019  
Testing End Date : Jan.22, 2019  
Test Result(s) : For further details, please refer to the following page(s)  
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

\*\*\*\*\* To be continued\*\*\*\*\*

Signed for  
SGS-CSTC Standards Technical  
Services Co., Ltd. Xiamen Branch  
Testing Center



---

Civi Huang Authorized Signatory

# TEST REPORT

No. : XMIN190100111CCM

Date : Jan.22, 2019

Page: 2 of 2

Slip resistance (oil-wet ramp test)

**Test Method:**

DIN 51130:2014-02 Testing of floor coverings - Determination of the anti-slip property - Workrooms and fields of activities with slip danger, walking method - Ramp test

**Sample Description:**

Floor, 1300mm×700mm, 1pc, see the photo(s)

**Test Result:**


Testing direction & testing surface: see the photo(s)

Test item(s)	Test result(s)	Classification
Slip resistance (oil-wet ramp test)	Critical angle of inclination: 7.8°	R9

**Classification of oil-wet ramp test:**

Classification	Angle (degrees)
R9	$6^{\circ} < X \leq 10^{\circ}$
R10	$10^{\circ} < X \leq 19^{\circ}$
R11	$19^{\circ} < X \leq 27^{\circ}$
R12	$27^{\circ} < X \leq 35^{\circ}$
R13	$> 35^{\circ}$

Specimen photograph(s):

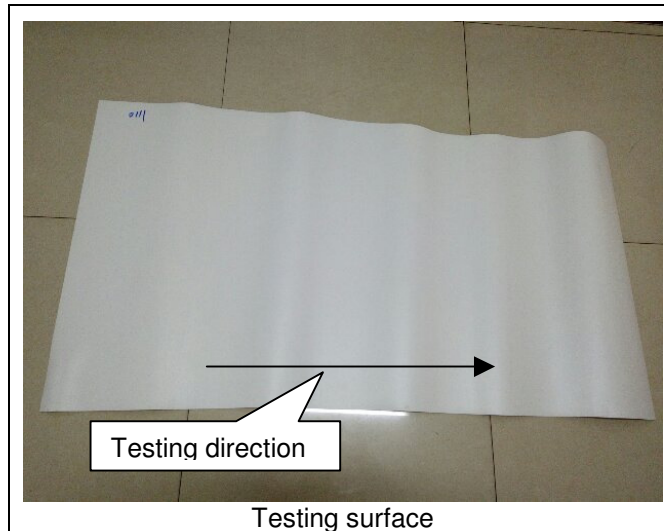

SGS authenticate the photo(s) on original report only  
 \*\*\*\*\*End of report\*\*\*\*\*